



Abstract

The thermal stabilization and cooling systems for the Time Projection Chamber "TPC" and Electromagnetic calorimeter "ECAL" detectors for the Multi-Purpose Detector "MPD" experiment (NICA project). The present experiment is focused on the verification of plastic hoses subjected to neutron irradiation as the candidate for supplying the distilled or deionized water to the cooling system of MPD. Presuming that the hoses will be located within the area of TPC Front End "FE" electronics, they should be resistant to neutron fluence of about  $10^{11}$  n/cm<sup>2</sup> (with the energy of 1 MeV). So, candidate plastic hoses were irradiated with neutrons (with an energy up to 1 MeV) with the following fluences: F1 =  $10^9$  n/cm<sup>2</sup>, F2 =  $10^{10}$  n/cm<sup>2</sup>, F3 =  $10^{11}$  n/cm<sup>2</sup>, and F4 =  $10^{12}$  n/cm<sup>2</sup>.


Raman spectroscopy, and air permeability measurements were performed to check plastic hoses status before and after irradiation. COMSOL Multi-physics modelling software is also being used to study the selected candidate pipes. Based on the research conducted, the Reinforced Polyvinyl chloride "PVC" hose was selected to be the best candidate for installing the thermal stabilization and cooling system.

Objective

The Time Projection Chamber (TPC) and the Electromagnetic Calorimeter (ECAL) are sub detectors of MPD experiment at NICA mega-science project (Nuclotron-based Ion Collider facility). Basic principles of operation of the thermal stabilization and cooling systems being created for the TPC and ECAL detectors. Both detectors use plastic hose pipes to supply the refrigerant with (distilled water or deionized water). The task is to choose a suitable material for pipes, which will ensure the operation of cooling systems about 10 years, and determine the permissible terms of their operation.

Cooling system of TPC Design.

The Time Projection Chamber (TPC) and the Electromagnetic Calorimeter (ECAL) are sub detectors of MPD experiment at NICA mega-science project (Nuclotron-based Ion Collider facility). Basic principles of operation of the thermal stabilization and cooling systems being created for the TPC and ECAL detectors. Both detectors use plastic hose pipes to supply the refrigerant with (distilled water or deionized water). The task is to choose a suitable material for pipes, which will ensure the operation of cooling systems about 10 years, and determine the permissible terms of their operation.

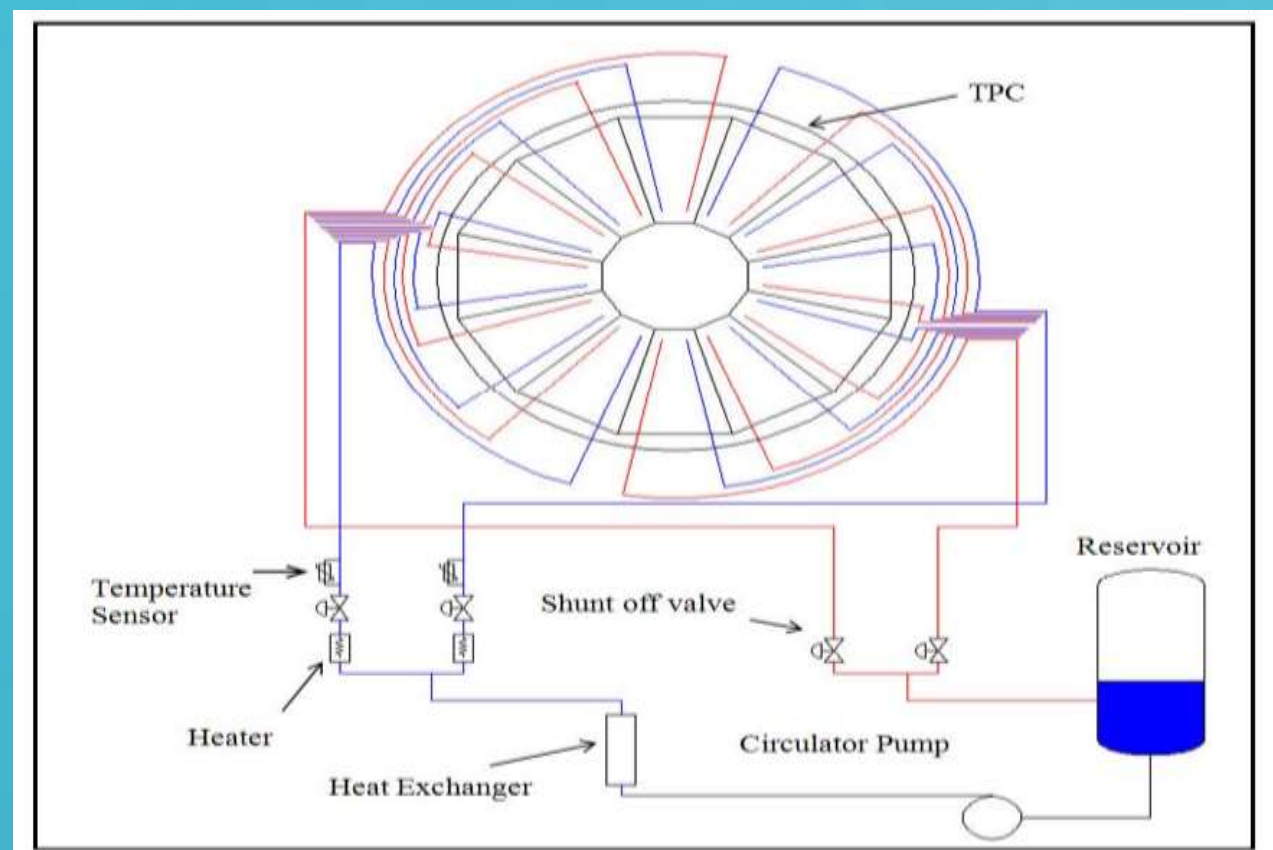

The Irradiation Environment for the Cooling System

The TPC Cooling system consists of 24 sub-circuits so that each read out chamber "ROC" is cooled by a dedicated sub-circuit. The coolant pumps up from the reservoir to thermal stabilization systems for cooling of Field Programmable Gate Array "FPGA", ECAL, Low Voltage Distribution Board "LVDB", added to cooling with the thermal stabilization of SAMP Amplifier, ROC Cases, outer thermal screen, internal thermal screen, and flanges, then after cooling, return through the heat exchanger to the main reservoir in a closed loop.

The neutron fluence for 10 years of operation of the MPD experiment showing

Neutrons fluence (for 1 MeV neutrons) -  $5 \times 10^{10}$  neutron/cm<sup>2</sup> (Neutron Flux: 250 n/cm<sup>2</sup> per sec);  
Neutrons fluence (for the entire neutron spectrum) -  $8 \times 10^{10}$  neutron/cm<sup>2</sup> (Neutron Flux: 400 n/cm<sup>2</sup> per sec).

Methodological


Due to the existence of the cooling pipes in the radioactive environment, we start our procedure to choose the optimum cooling pipes from a variety of candidate hose pipes by applying a variety of analysis: chemical (Raman spectroscopy), diffusion tests for all the candidate pipes before and after irradiation. Table : Samples of candidate pipes into our study and their Young's modulus.

| No | Title                                   | Mass     | E   |
|----|---|----------|-----|
| 1  | Reinforced Polyvinyl chloride (PVC)     | 640      | 2.6 |
| 2  | Reinforced Silicone                     | -        | -   |
| 3  | Polytetrafluoroethylene (PTFE) "Teflon" | 78       | 0.5 |
| 4  | Polyurethane                            | Optional | 260 |
| 5  | Polydimethylsiloxane (PDMS) "Silicone"  | 130      | 0.1 |

The first procedure of practical analysis is initiated by neutron irradiation for the candidate cooling Pipes.

The first procedure needed before starting the analysis is to check the quality of the candidate pipes for the cooling system, which is to irradiate the pipe samples before applying the variety of analysis for the candidate pipes before and after irradiation, then obtain the optimum ones.

Energy Spectrum for Neutrons Used for hose pipes Irradiation.

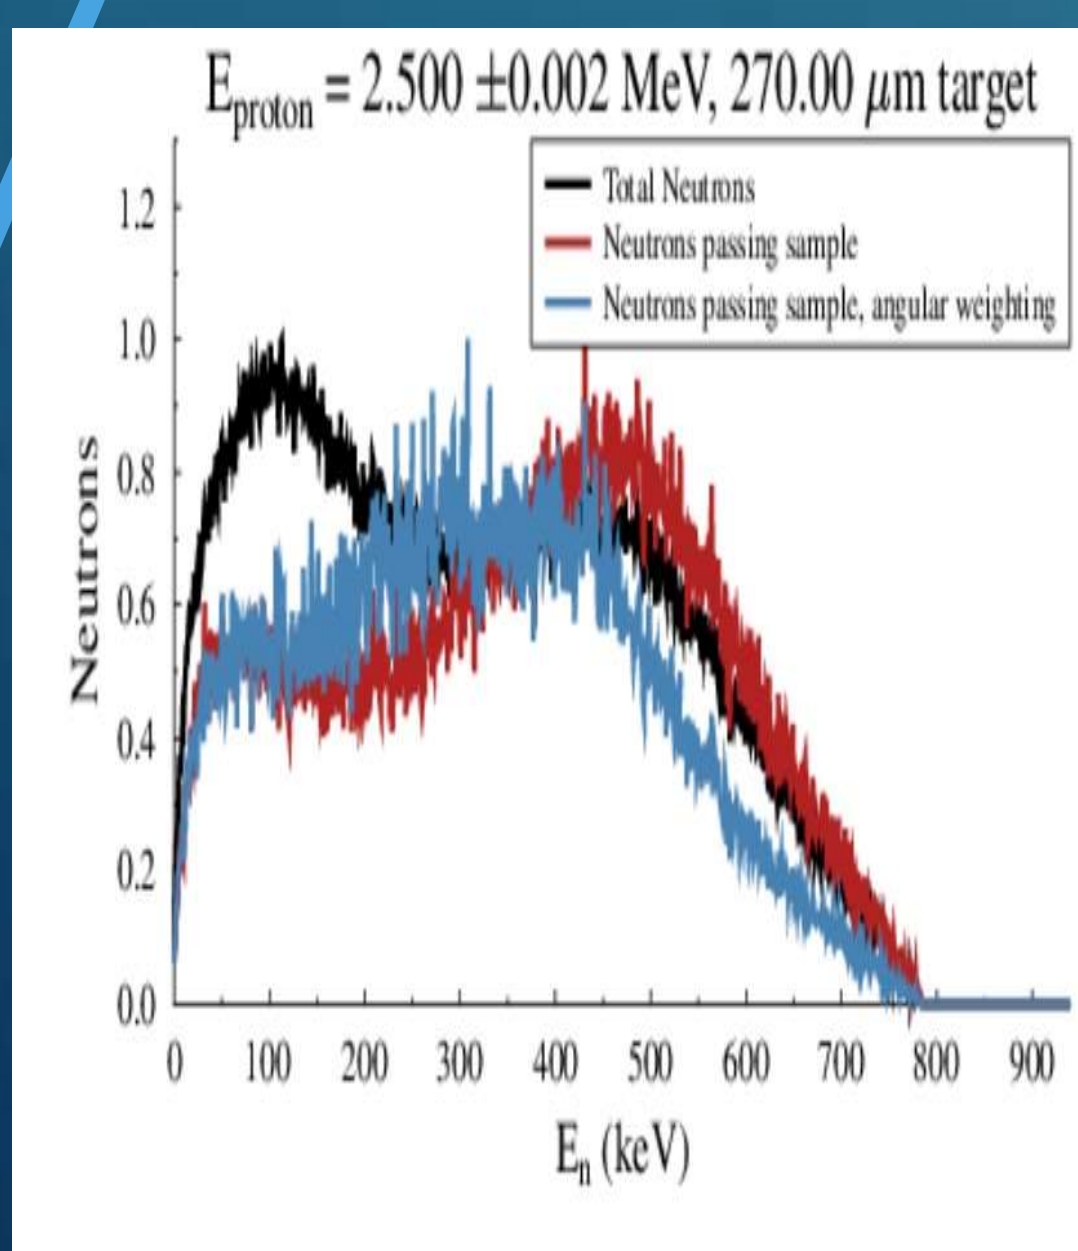

The implementation of irradiation by neutrons occurred with the neutrons generated in the EG-5 electrostatic accelerator in the Neutron Physics Laboratory of the Joint Institute for Nuclear Research. Neutrons are generated on a lithium target 270 μm thickness and 1 cm<sup>2</sup> in area. The threshold energy of the neutron spectrum from the <sup>7</sup>Li (p, n) and <sup>9</sup>Be (p, n) reactions is 1912 keV.

The target was irradiated by a proton beam with an energy of 2.5 MeV on a van de Graaf electrostatic generator EG-5. The proton beam current was 10 μA. The energy of the generated neutrons was in the range of 20–800 keV.

The calculated neutron flux density was  $0.87 \times 10^{10}$  n/cm<sup>2</sup>.sec. Cooling hose pipes are irradiated with neutrons (with an energy up to 1 MeV) with the following integral fluences values: F=10<sup>9</sup>, 10<sup>10</sup>, 10<sup>11</sup>, and 10<sup>12</sup> neutrons/cm<sup>2</sup>.

Thermal Stabilization and Cooling System for the TPC and ECAL Detectors of the MPD Experiment on the Collider Facility "NICA"


Youmna Ghoneim, Sergey Movchan, Aleksey Bazhazhin, Aleksandr Doroshkevich, Rafael Isayev, Ilya Chepurchenko, Grygory Arzumanyan, Alexander Fedotov, Kahramon Mamatkulov.

e-Mail: youmnasami24@gmail.com


Raman spectroscopy as a Chemical Analysis

Raman spectroscopy provides a robust analytical instrument that is capable of capturing vibrational frequencies with high resolution and specificity. It provides detailed spectral information corresponding to the vibrational modes of the samples under examination. Furthermore, the fingerprint regions of Raman spectra provide insights into the changes that occur, which in turn aid in the identification of critical structural motifs associated with the progression of degradation. Therefore, by utilizing the capacity of Raman spectroscopy to discern vibrational frequencies and assign them to distinct bonding regions, the intricate interplay of structural dynamics in samples can be elucidated. As a spectroscopic and analytical approach, the results obtained through Raman spectroscopy not only enhance our understanding of the structural changes of polymer samples at the molecular level.

The Raman spectra of the pristine and irradiated PDMS.

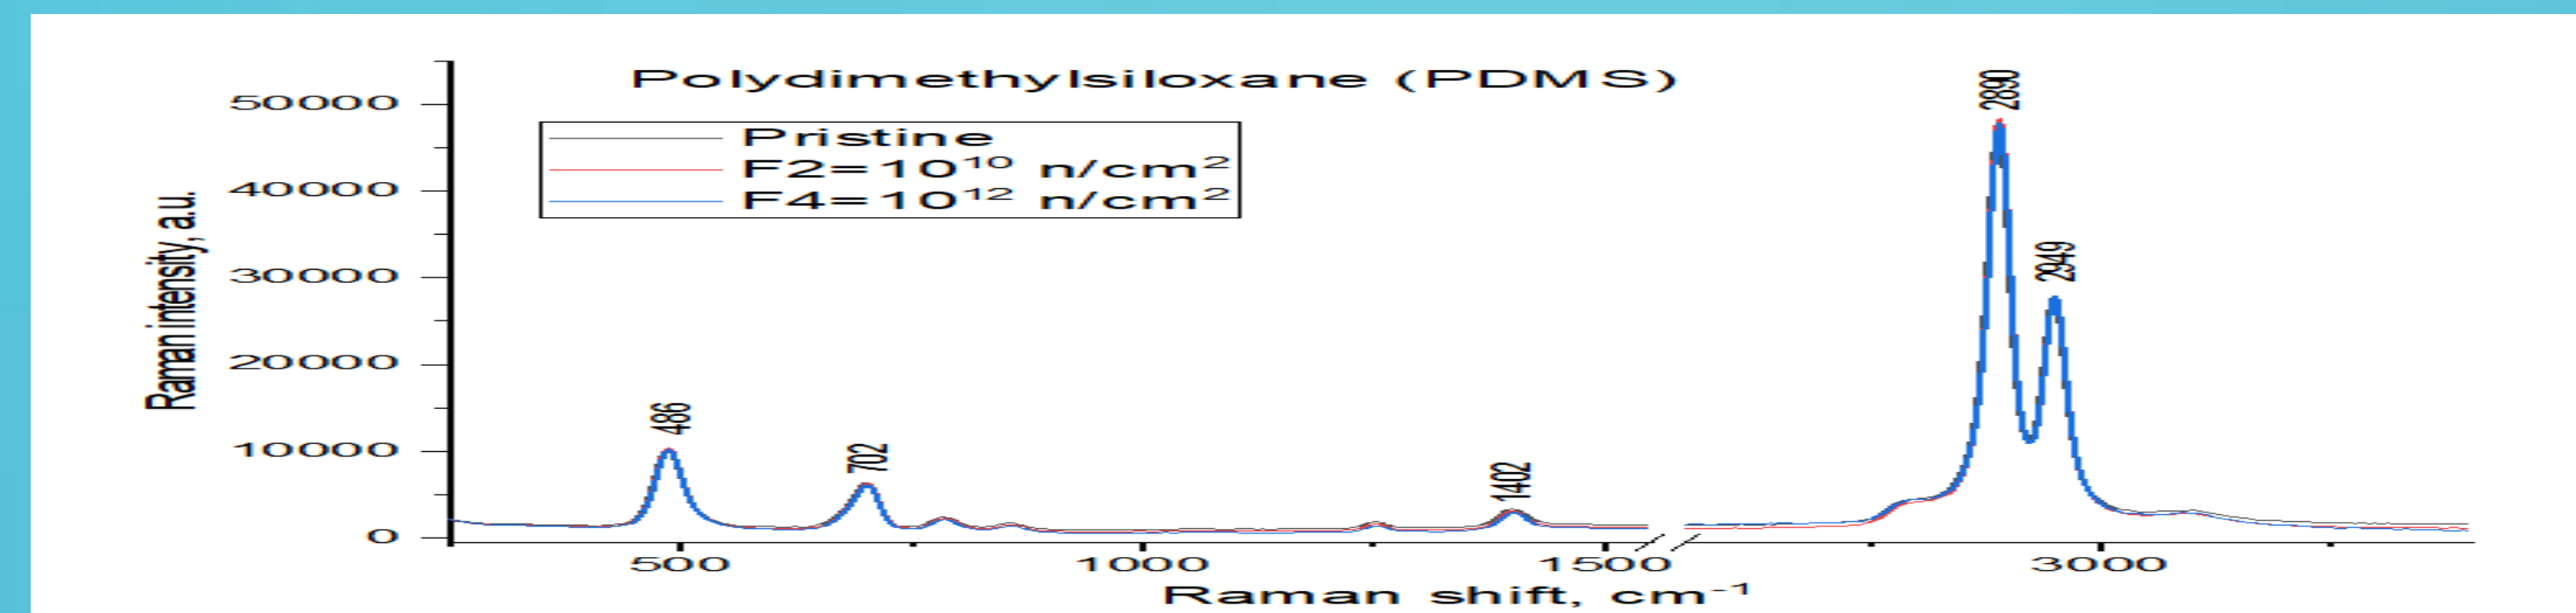


The Raman spectra of the pristine and irradiated PTFE.

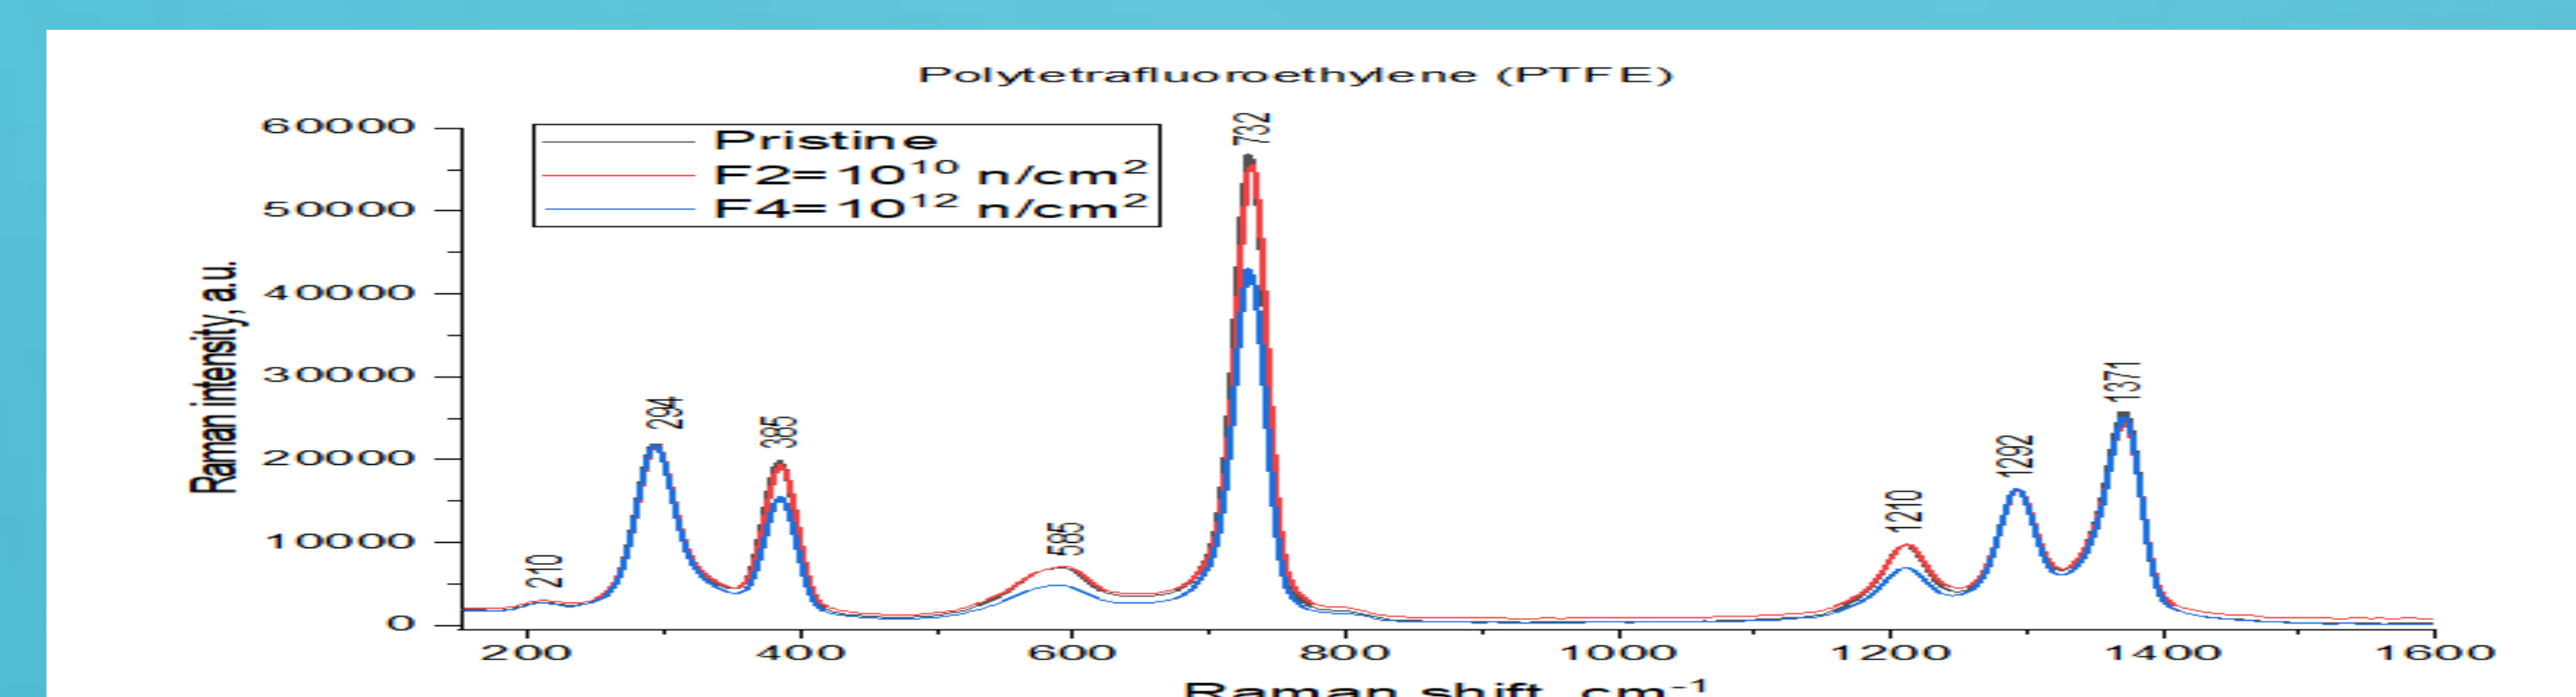


The Raman spectra of the PVC copolymer, comprising two distinct components (designated white and red), are illustrated in Figures 5 and 6, respectively. The white component is more solid and predominantly comprises PVC, as evidenced by the presence of peaks at 612 and 688 cm<sup>-1</sup>, which correspond to the skeletal and C-Cl stretching vibrations, respectively. Additionally, peaks at 1080, 1170, 1320, 1438 and 1598 cm<sup>-1</sup> are attributable to the PVC copolymer.

The red component also comprises PVC with a minor addition of rubber, which endows the material with enhanced flexibility. This is evidenced by the emergence of supplementary peaks at frequencies 1032, 1198 and 1383cm<sup>-1</sup>. The degradation of PVC by the elimination of HCl and the formation of all-trans polyenes is a well-established phenomenon, with a substantial body of documented evidence.


The Raman spectra of the pristine and irradiated PVC – white component.

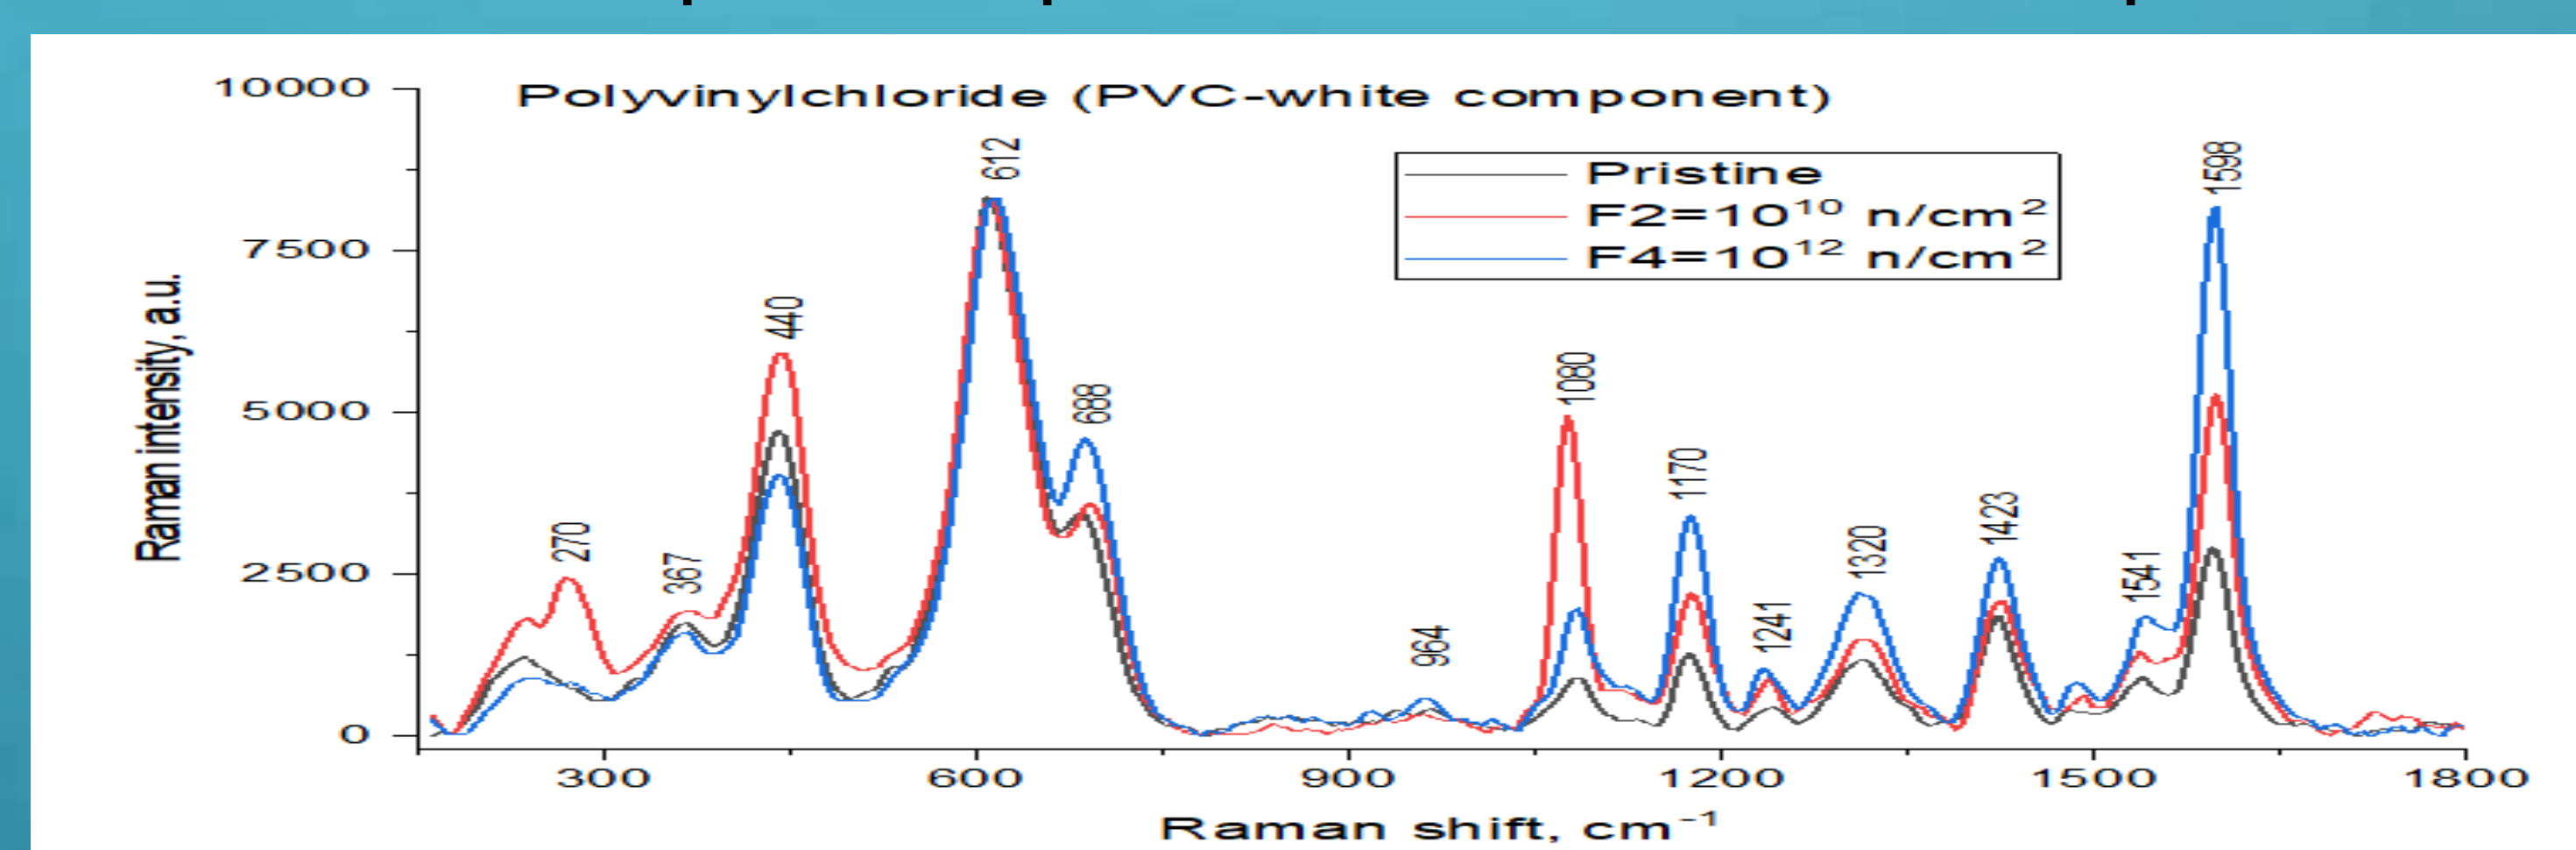

The Raman spectra of the pristine and irradiated PVC – red component.

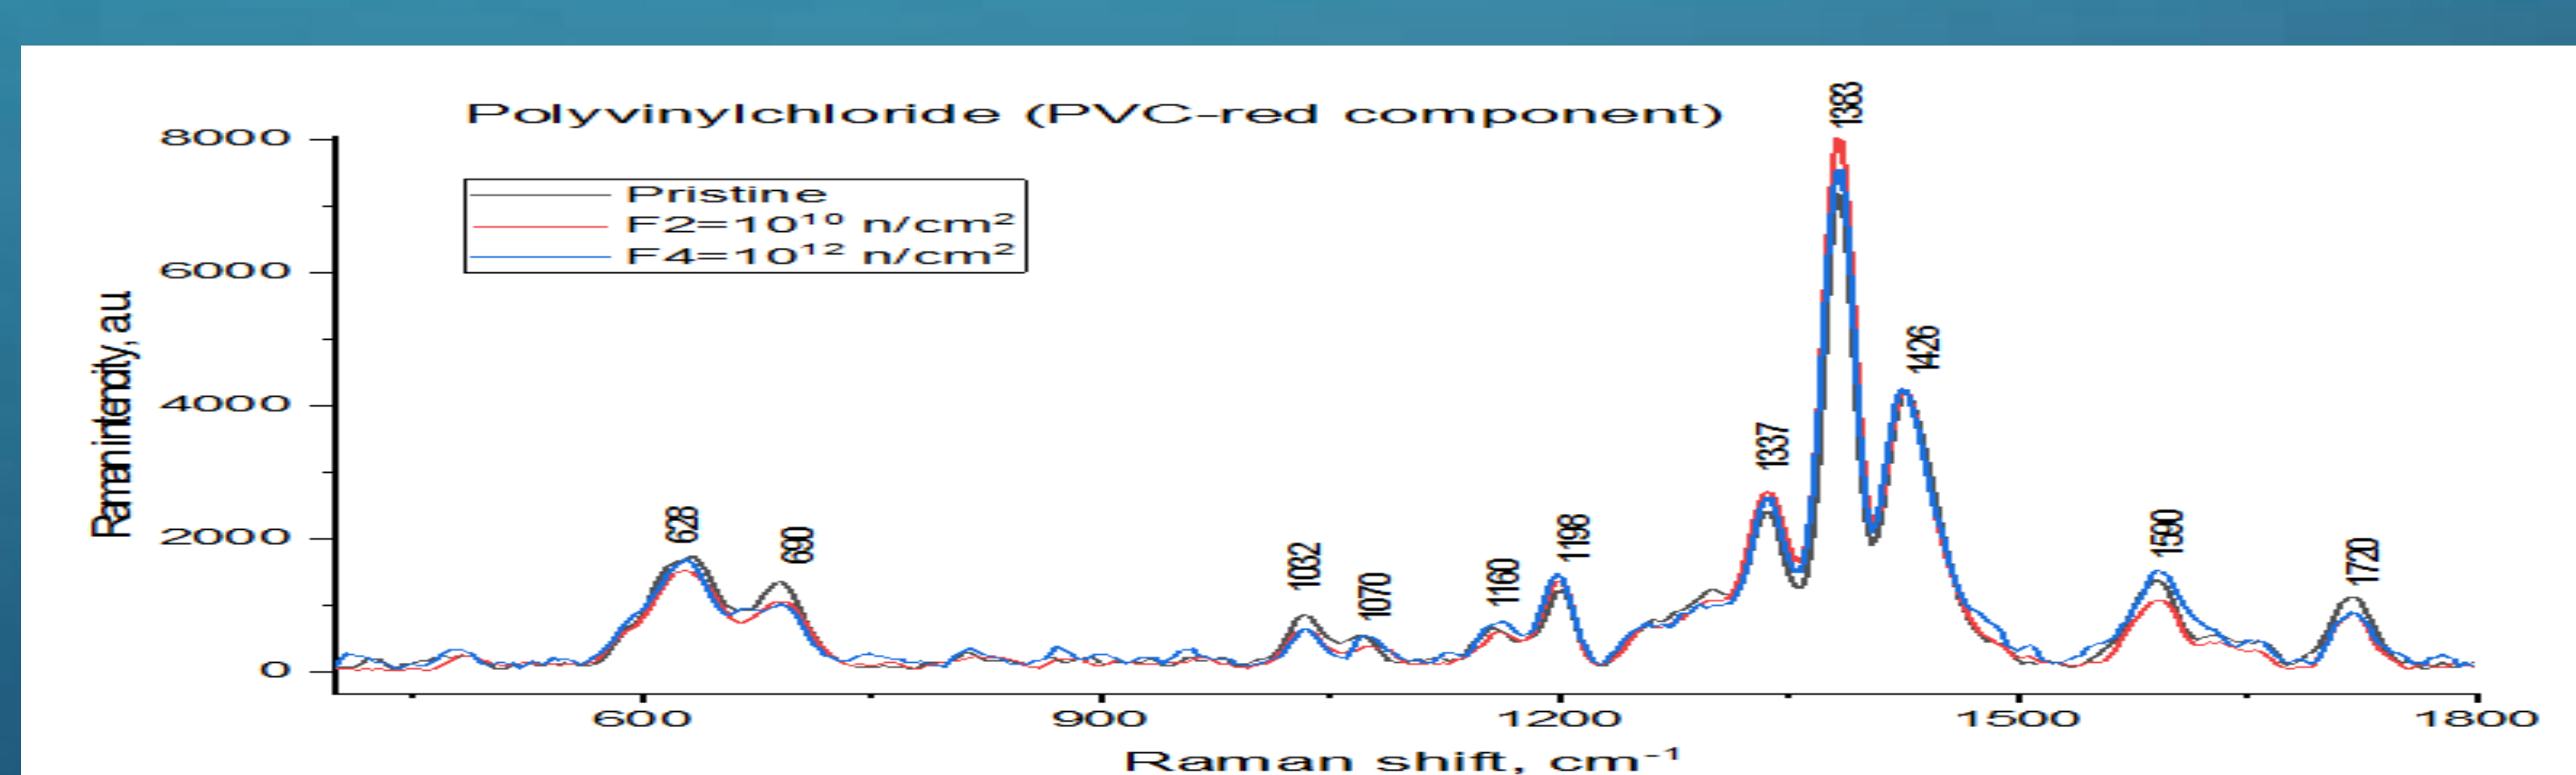


The Raman spectra of the pristine and irradiated Polyurethane.

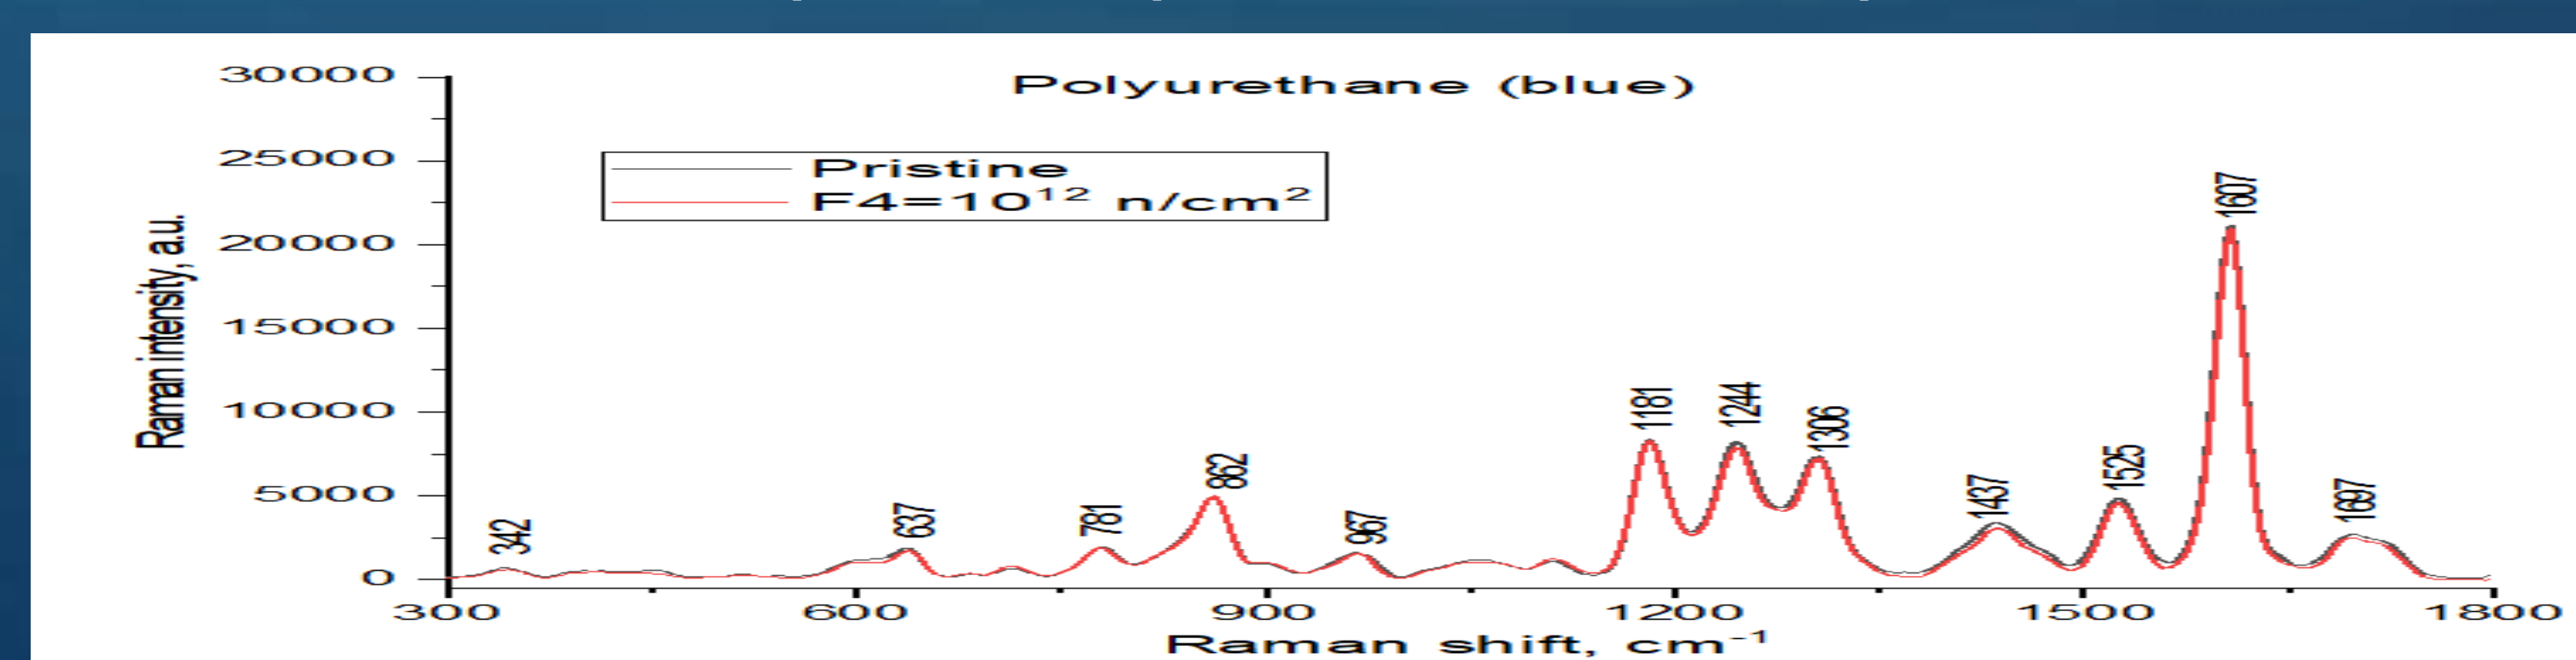

COMSOL Multi-Physics Modelling

COMSOL Multi-Physics Software has been used to model for the Cooling process, based on the Reinforced PVC hose pipes with the coolant water, the Reinforced PVC pipes surrounded by air that exist in a radioactive environment of spectrum neutrons in range of 1 MeV neutrons.

A) Geometry, B) Mesh analysis used in COMSOL for three domains of coolant as a Domain one and Reinforced PVC for the hose Pipe as a second

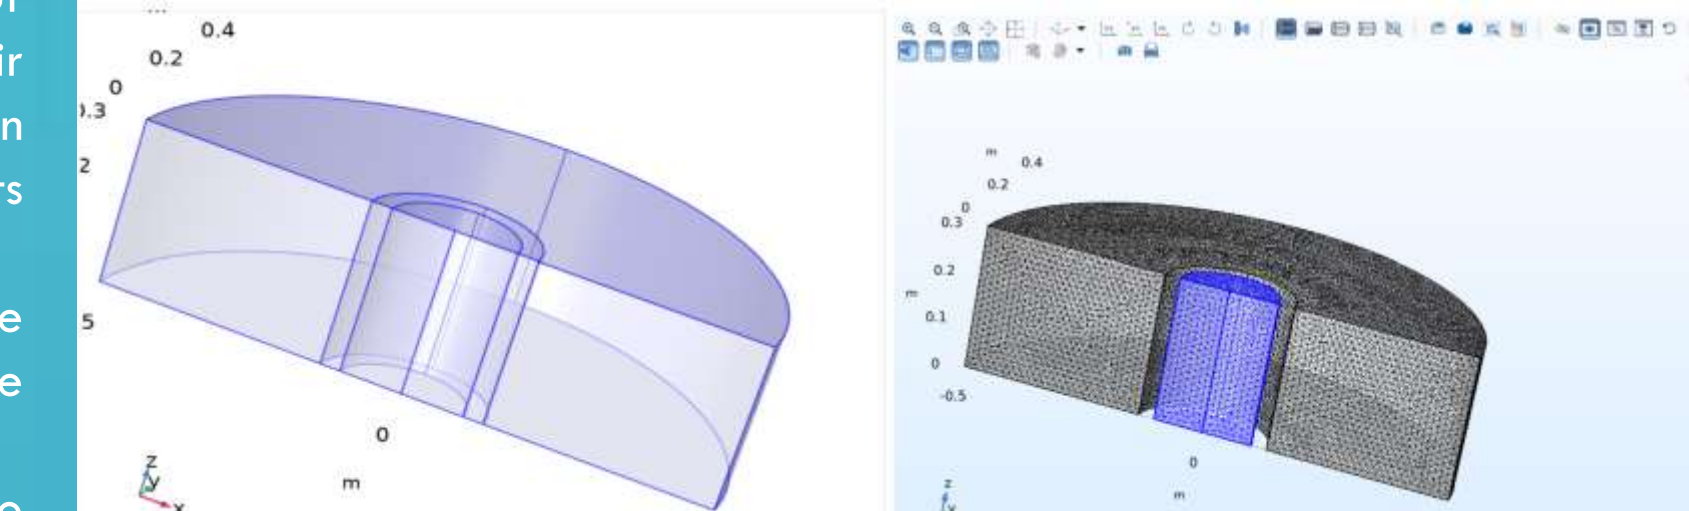


Laminar flow for both the two fluids of the water coolant and air surrounding the main geometry.

$$\rho(u \cdot \nabla)u = \nabla \cdot [-pI + K] + F$$


$$\nabla \cdot (\rho \cdot u) = 0$$

$$K = \mu (\nabla u + (\nabla u)^T) - \frac{2}{3} \mu (\nabla \cdot u)I$$

Here are the numerical results for the velocity model for both the two domains of the coolant and the air surrounding the reinforced PVC hose Pipe; based on COMSOL physics, as it is a laminar flow for semi-compressible liquid with a time-dependent study of physics.

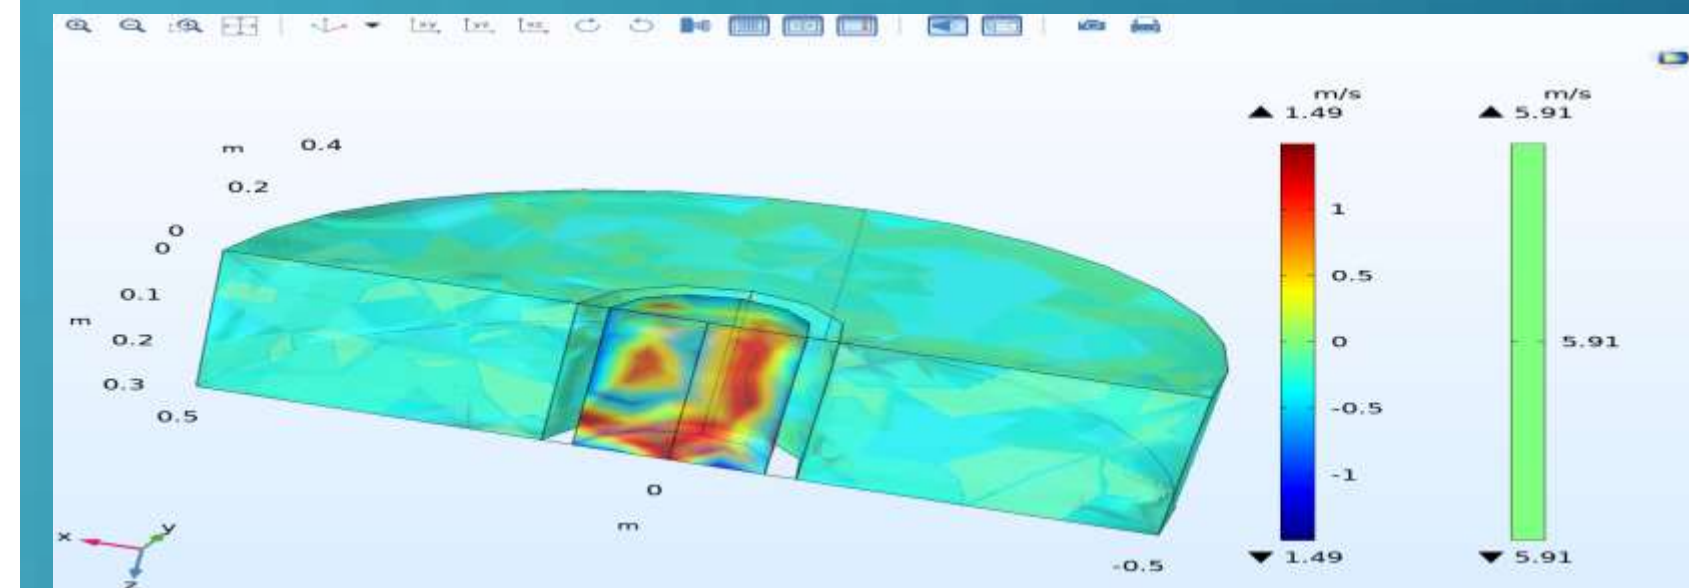


the numerical results for the Pressure Model for the three domains of the coolant, the air surrounding the reinforced PVC hose Pipe; based on the COMSOL physics, as it is a laminar flow for semi-compressible liquid with a time-dependent study of physics.

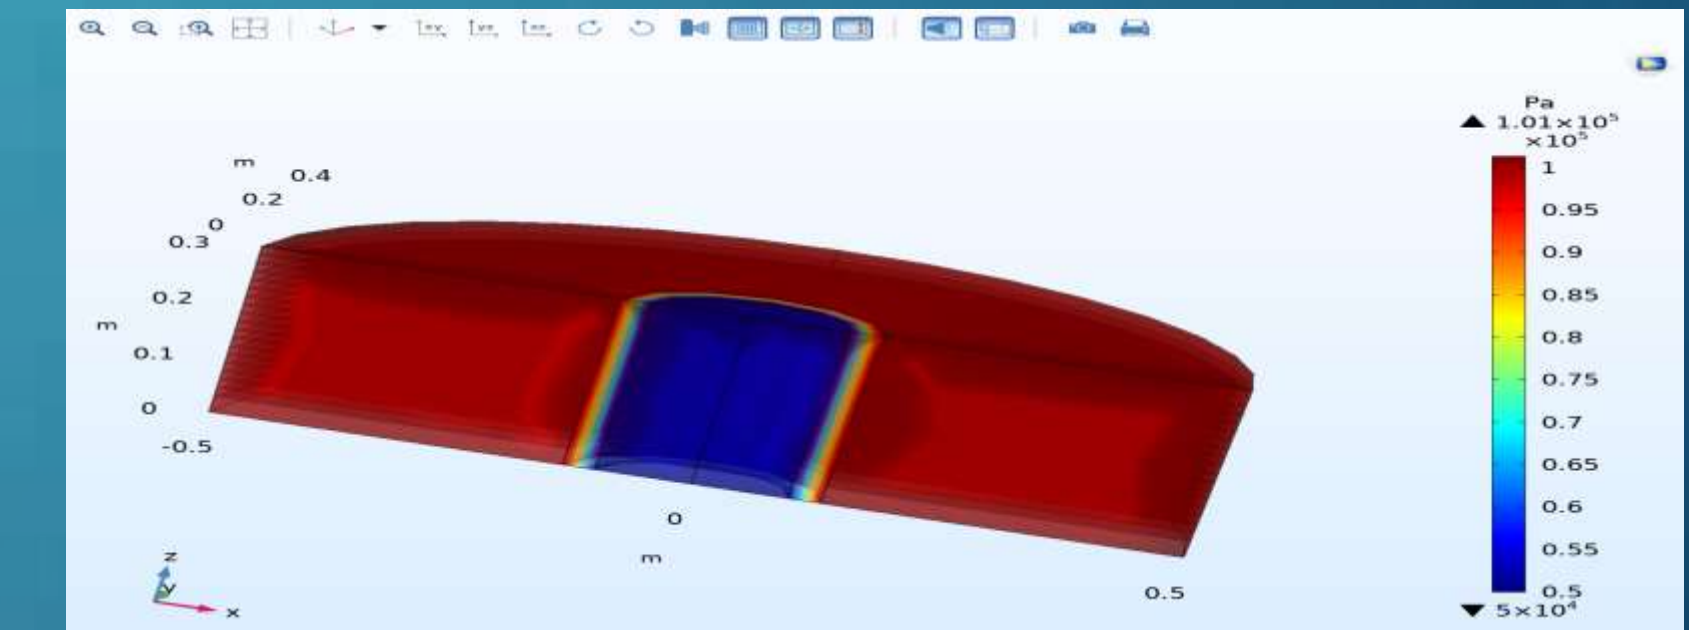


Heat transfer for both the two fluids of the water coolant and air surrounding the main geometry, added to the Reinforced PVC hose pipe.

$$\rho C_p \left( \frac{\partial T}{\partial t} + u \text{trans} \cdot \nabla T \right) + \nabla \cdot (qr + q) = -\alpha T \frac{ds}{dt} + Q$$

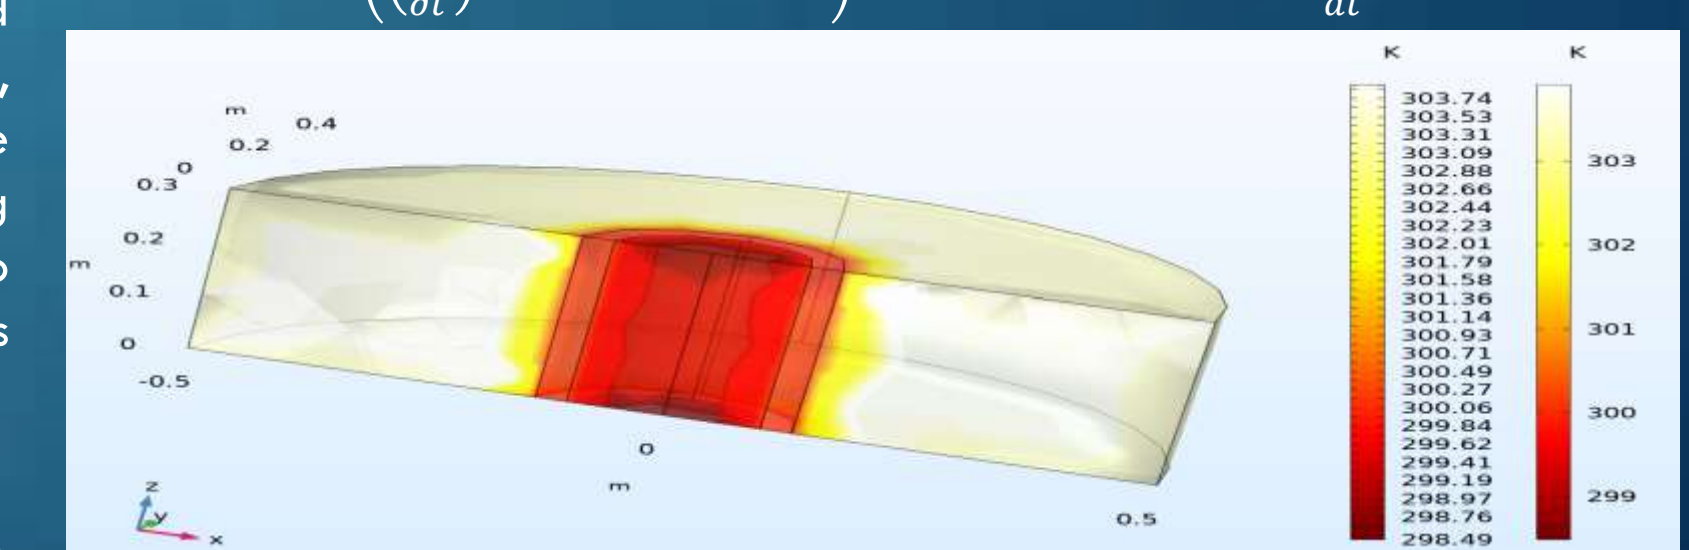


The Magnetic Fields Interface

based on the electromagnetic equations used, because there is a detectable difference for relative permeability and electrical conductivity for the three domains of water coolant, air, and reinforced PVC hose pipe. Considering the current analysis, it should be moved to the upcoming research to study the influence of magnetic field variation on the reinforced PVC hose pipe.

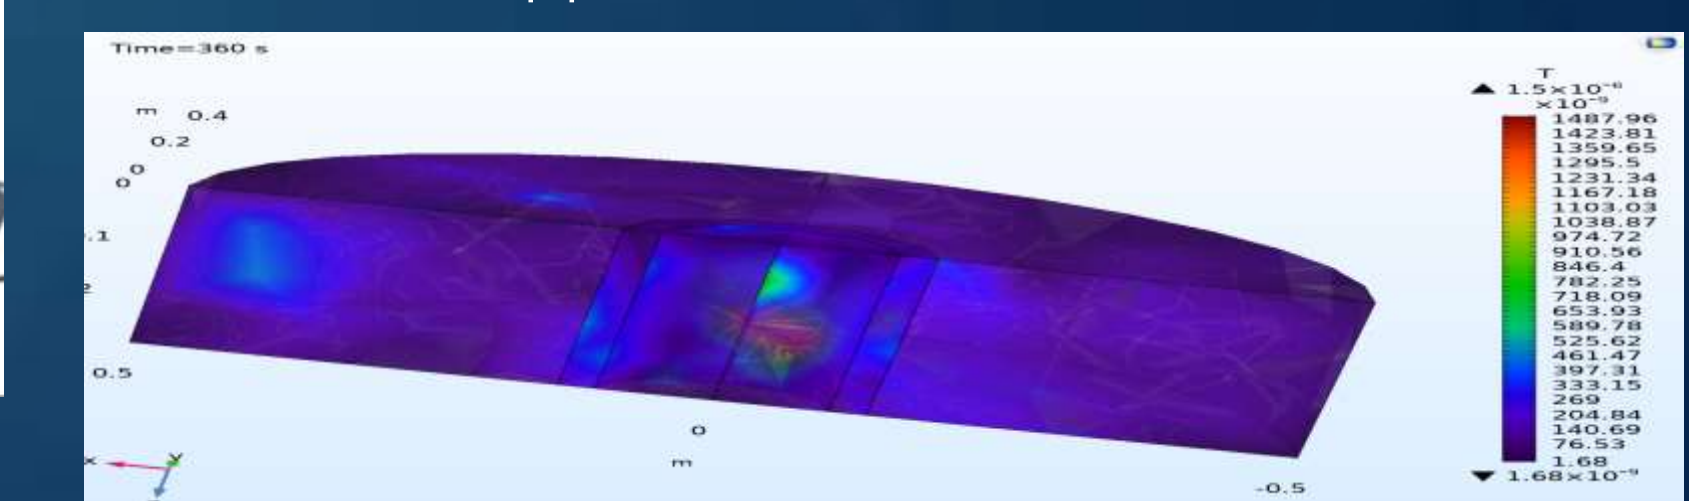

Neutron Fluence Distribution using the Coefficient of PDE Physics

neutrons are distributed semi-uniformly, taking into account the distribution of neutrons will be impacted by changes in the absorption rate, scattering rate, and diffusion rate for the three domain materials—air, reinforced PVC, and water coolant—neutrons are dispersed semi-uniformly.

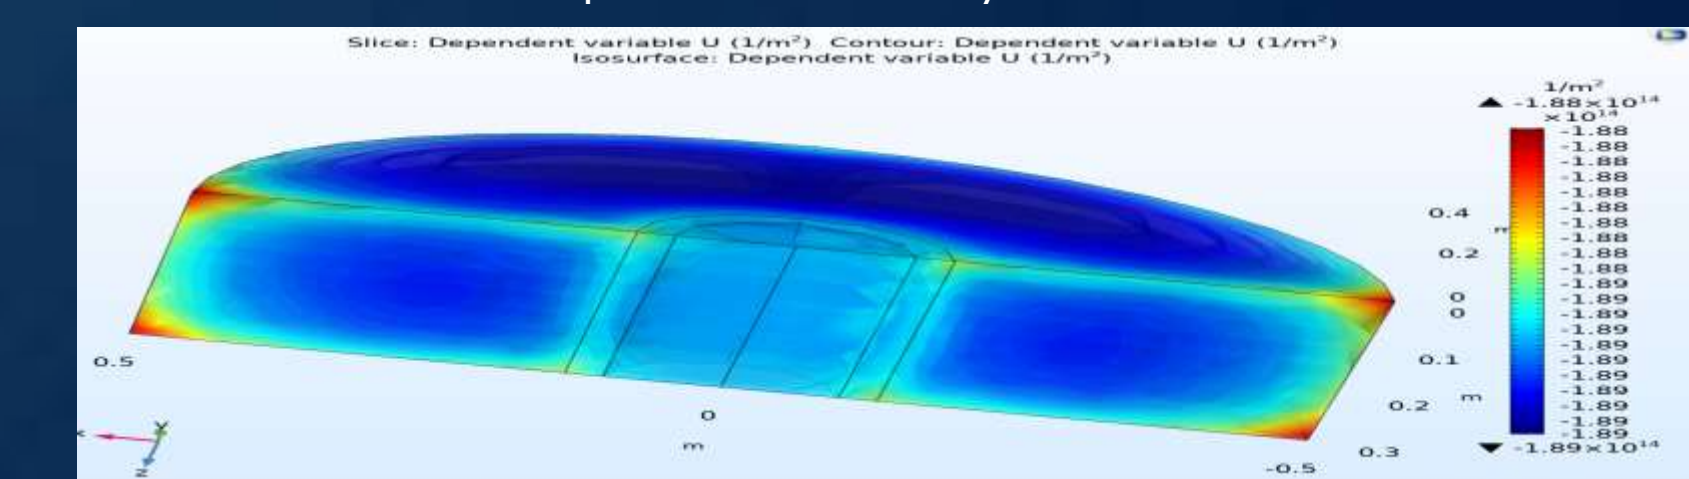

Conclusion

The results of the leakage analysis test for "reinforced PVC" conducted on both irradiated and non-irradiated samples under vacuum pressure showed that there was almost no leakage rate.

Polyurethane is a good option for cooling hose pipes. The leakage analysis test for polyurethane found that there is almost no leakage rate for both irradiated and non-irradiated samples that operated under vacuum pressure.

The Estimation Leakage for All MPD System for irradiated reinforced PVC hose pipe is about 2.4 cm<sup>3</sup>/min, and for non-irradiated reinforced PVC hose pipe is about 2.17 cm<sup>3</sup>/minute.

Leakage Test Analysis and Diffusion Analysis Through Polymer Membranes

Leakage tests are the tests that are subjected to after the production of products that do not want to be leakage. Air leakage tests include air leakage tests of manufactured products. These tests are based on monitoring the pressure change as a result of air inflation of the products to be tested.


Measurement for air leakage (diffusivity) from the atmosphere into the inside of the hose pipe with the air pumped out inside; the pressure inside the air was measured by a pressure sensor.

In the leakage analysis for the hose pipe analysis, the study based on two various leakage test devices to initiate more accurate results (Ley-bold Phoenix Quadro Dry and Pfeiffer Vacuum Device), which show the approximate same results analysis.

Diffusion Analysis Through Polymer Membranes

This test set-up is designed to fit several constraints, namely 1) to use a wide exchange surface area between gas and polymer membrane to maximize gas flowrates, 2) to measure very low gas flowrates.

Geometrical Stabilization for The Installation of Diffusion Analysis for The Polymer Membrane Using COMSOL solid mechanics software.

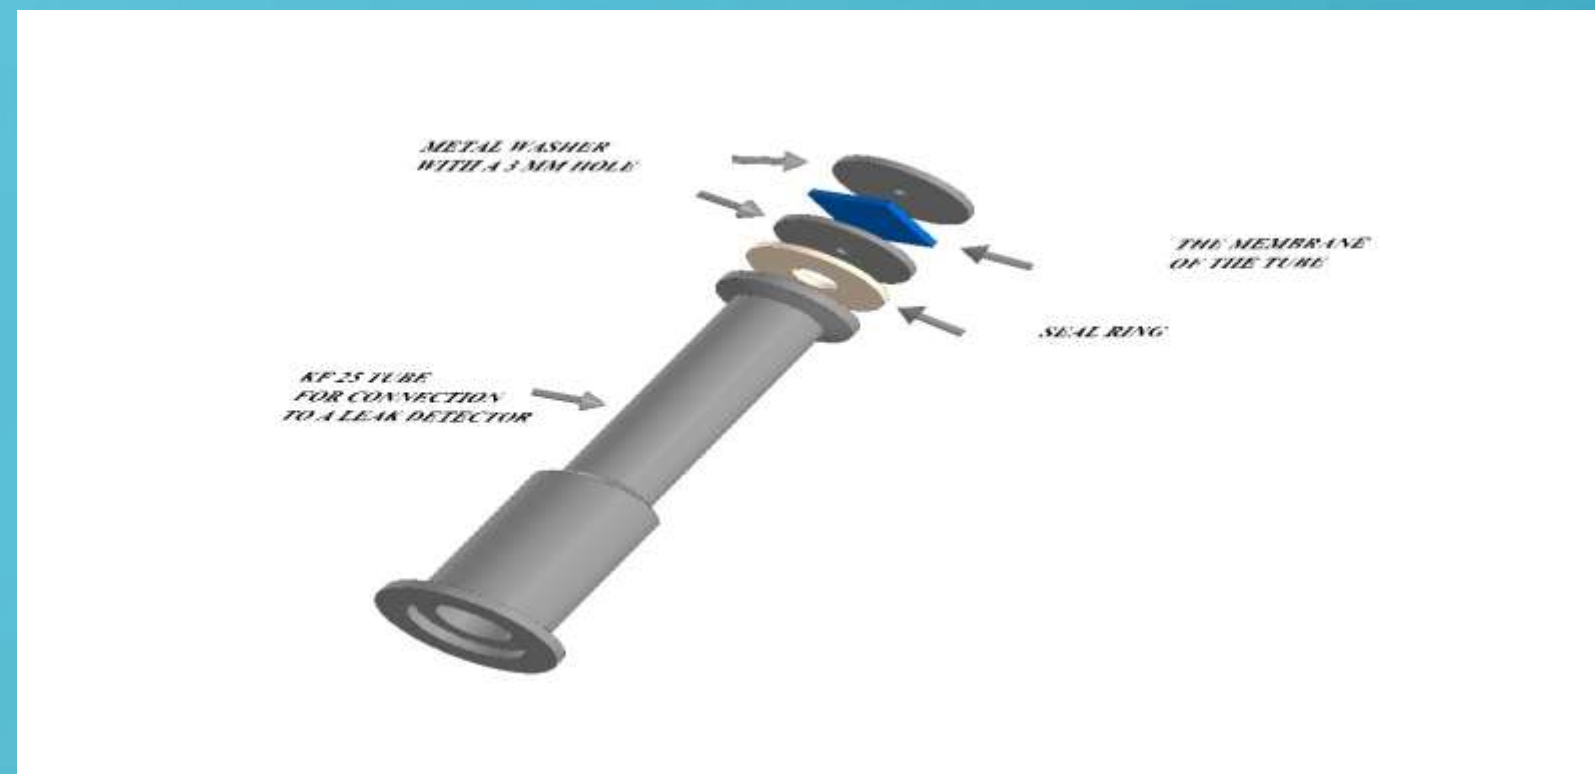

Diffusion membrane analysis test for the silicon observed that there is a high leakage rate for both samples irradiated and non-irradiated when operated in fore vacuum pressure, which means that silicon can't be operated as a cooling hose pipe.

The diffusion membrane analysis for Polyurethane observed that there is approximately no leakage rate for both samples irradiated and non-irradiated, which operated in fore vacuum pressure, which means that Polyurethane is the best candidate for a cooling hose pipe used in thermal electronics with a fore vacuum pressure cooling system.


Air Leakage Test

The Tracer Gas Method


The tracer gas method is a method based on measuring the change over time of a special gas that is filled homogeneously into the volume to be determined by the air leakage value. Some tracer gas leakage test methods include helium mass spectrometry, hydrogen leakage testing and refrigerant gas leakage for cooling applications.

Leakage analysis test for reinforced silicon shows that both irradiated and non-irradiated samples squeezed once operating at fore vacuum pressure, which means that the reinforced silicon can't be used for cooling of the thermal stabilization that is operated in a fore vacuum pressure cooling system, also analysis for polyurethane based on a Ley-bold Phoenix Quadro Dry test leakage device has been studied and indicates that polyurethane is the best candidate for a cooling hose pipe with no leakage.

A) analysis for Polyurethane based on (Ley-bold Phoenix Quadro Dry) test leakage device, B) leakage test analysis for reinforced silicon, which is directly squeezed once fore vacuum pressure is initiated.

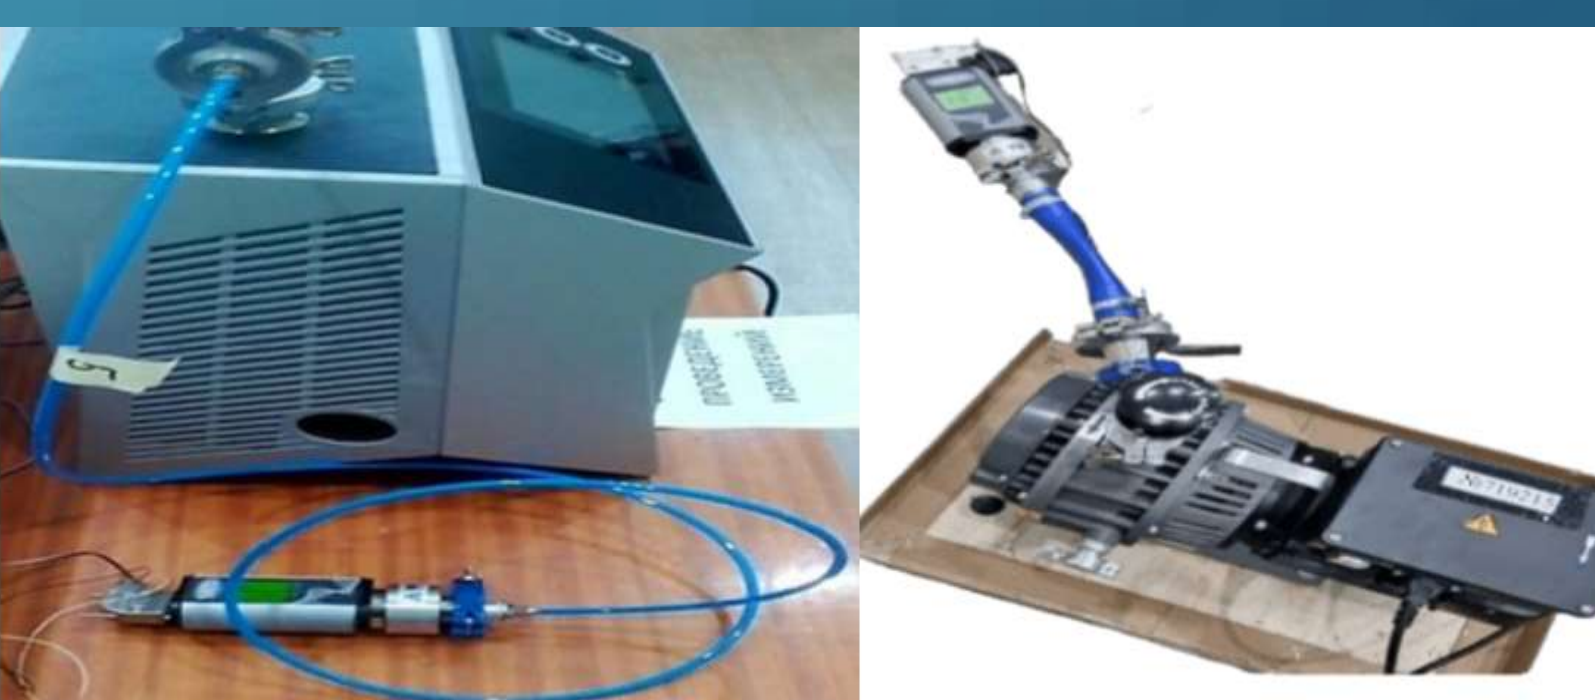

Leakage analysis for a reinforced PVC sample shows that the irradiation influence on the PVC hosing pipe to check the diffusion membrane test is quite the same influence for the two samples before and after irradiation

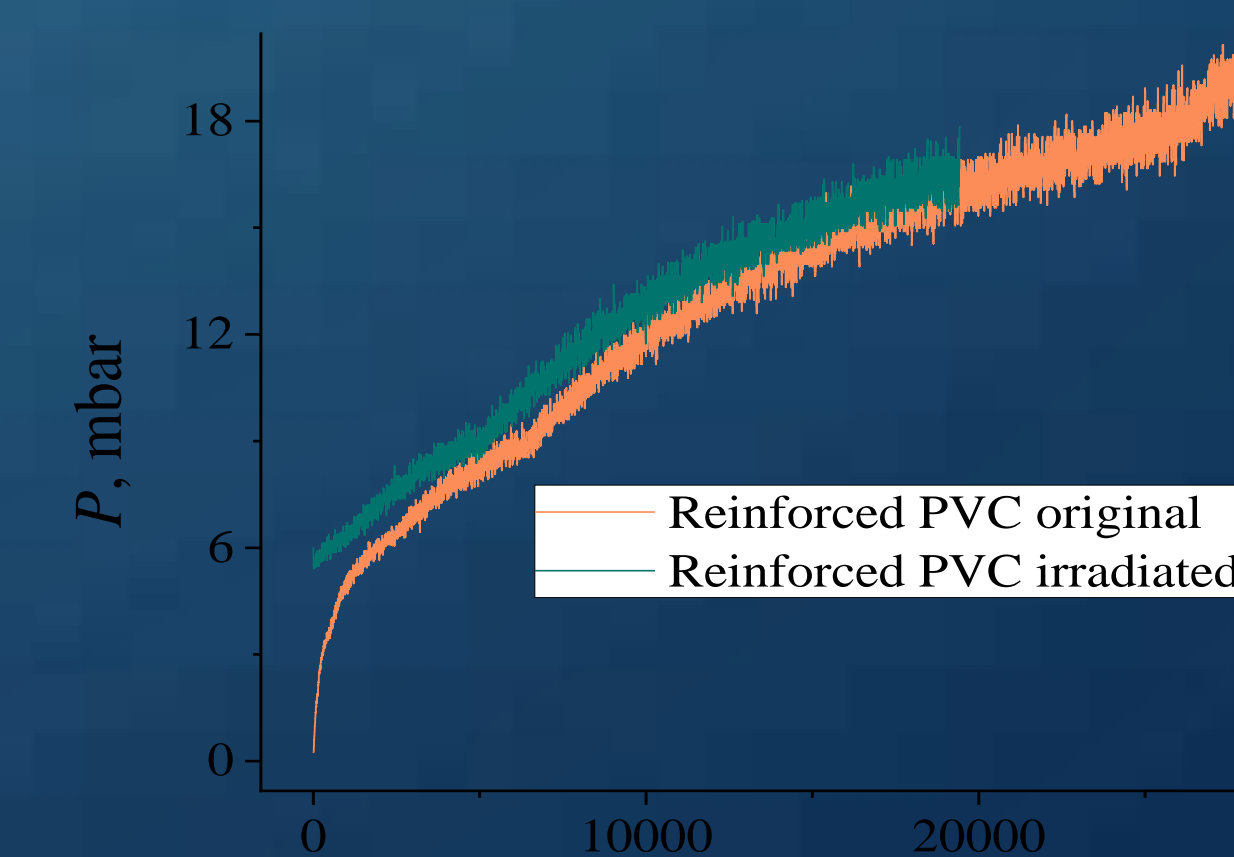

Leakage analysis test for the reinforced PVC observed that there is approximately no leakage rate for both samples irradiated and non-irradiated, which operated in fore vacuum pressure, which means that reinforced PVC is the best candidate for a cooling hose pipe.